
New Peel Farm Craddocks Moss Farm Contains OS data (C) Crown copyright and database right 2024. To use: Contains Environment Agency information (C) Environment Agency and/or database rights. Contains data derived from BGS digital data under licence from the British Geological Survey copyright NERC. This document is the property of Jeremy Benn Associates Ltd. It shall not 0 JBA be reproduced in whole or in part, consulting not disclosed to a third party, without the permission of Jeremy Benn Associates Ltd.

High Foxley Farm

Brockwood Hill Farm

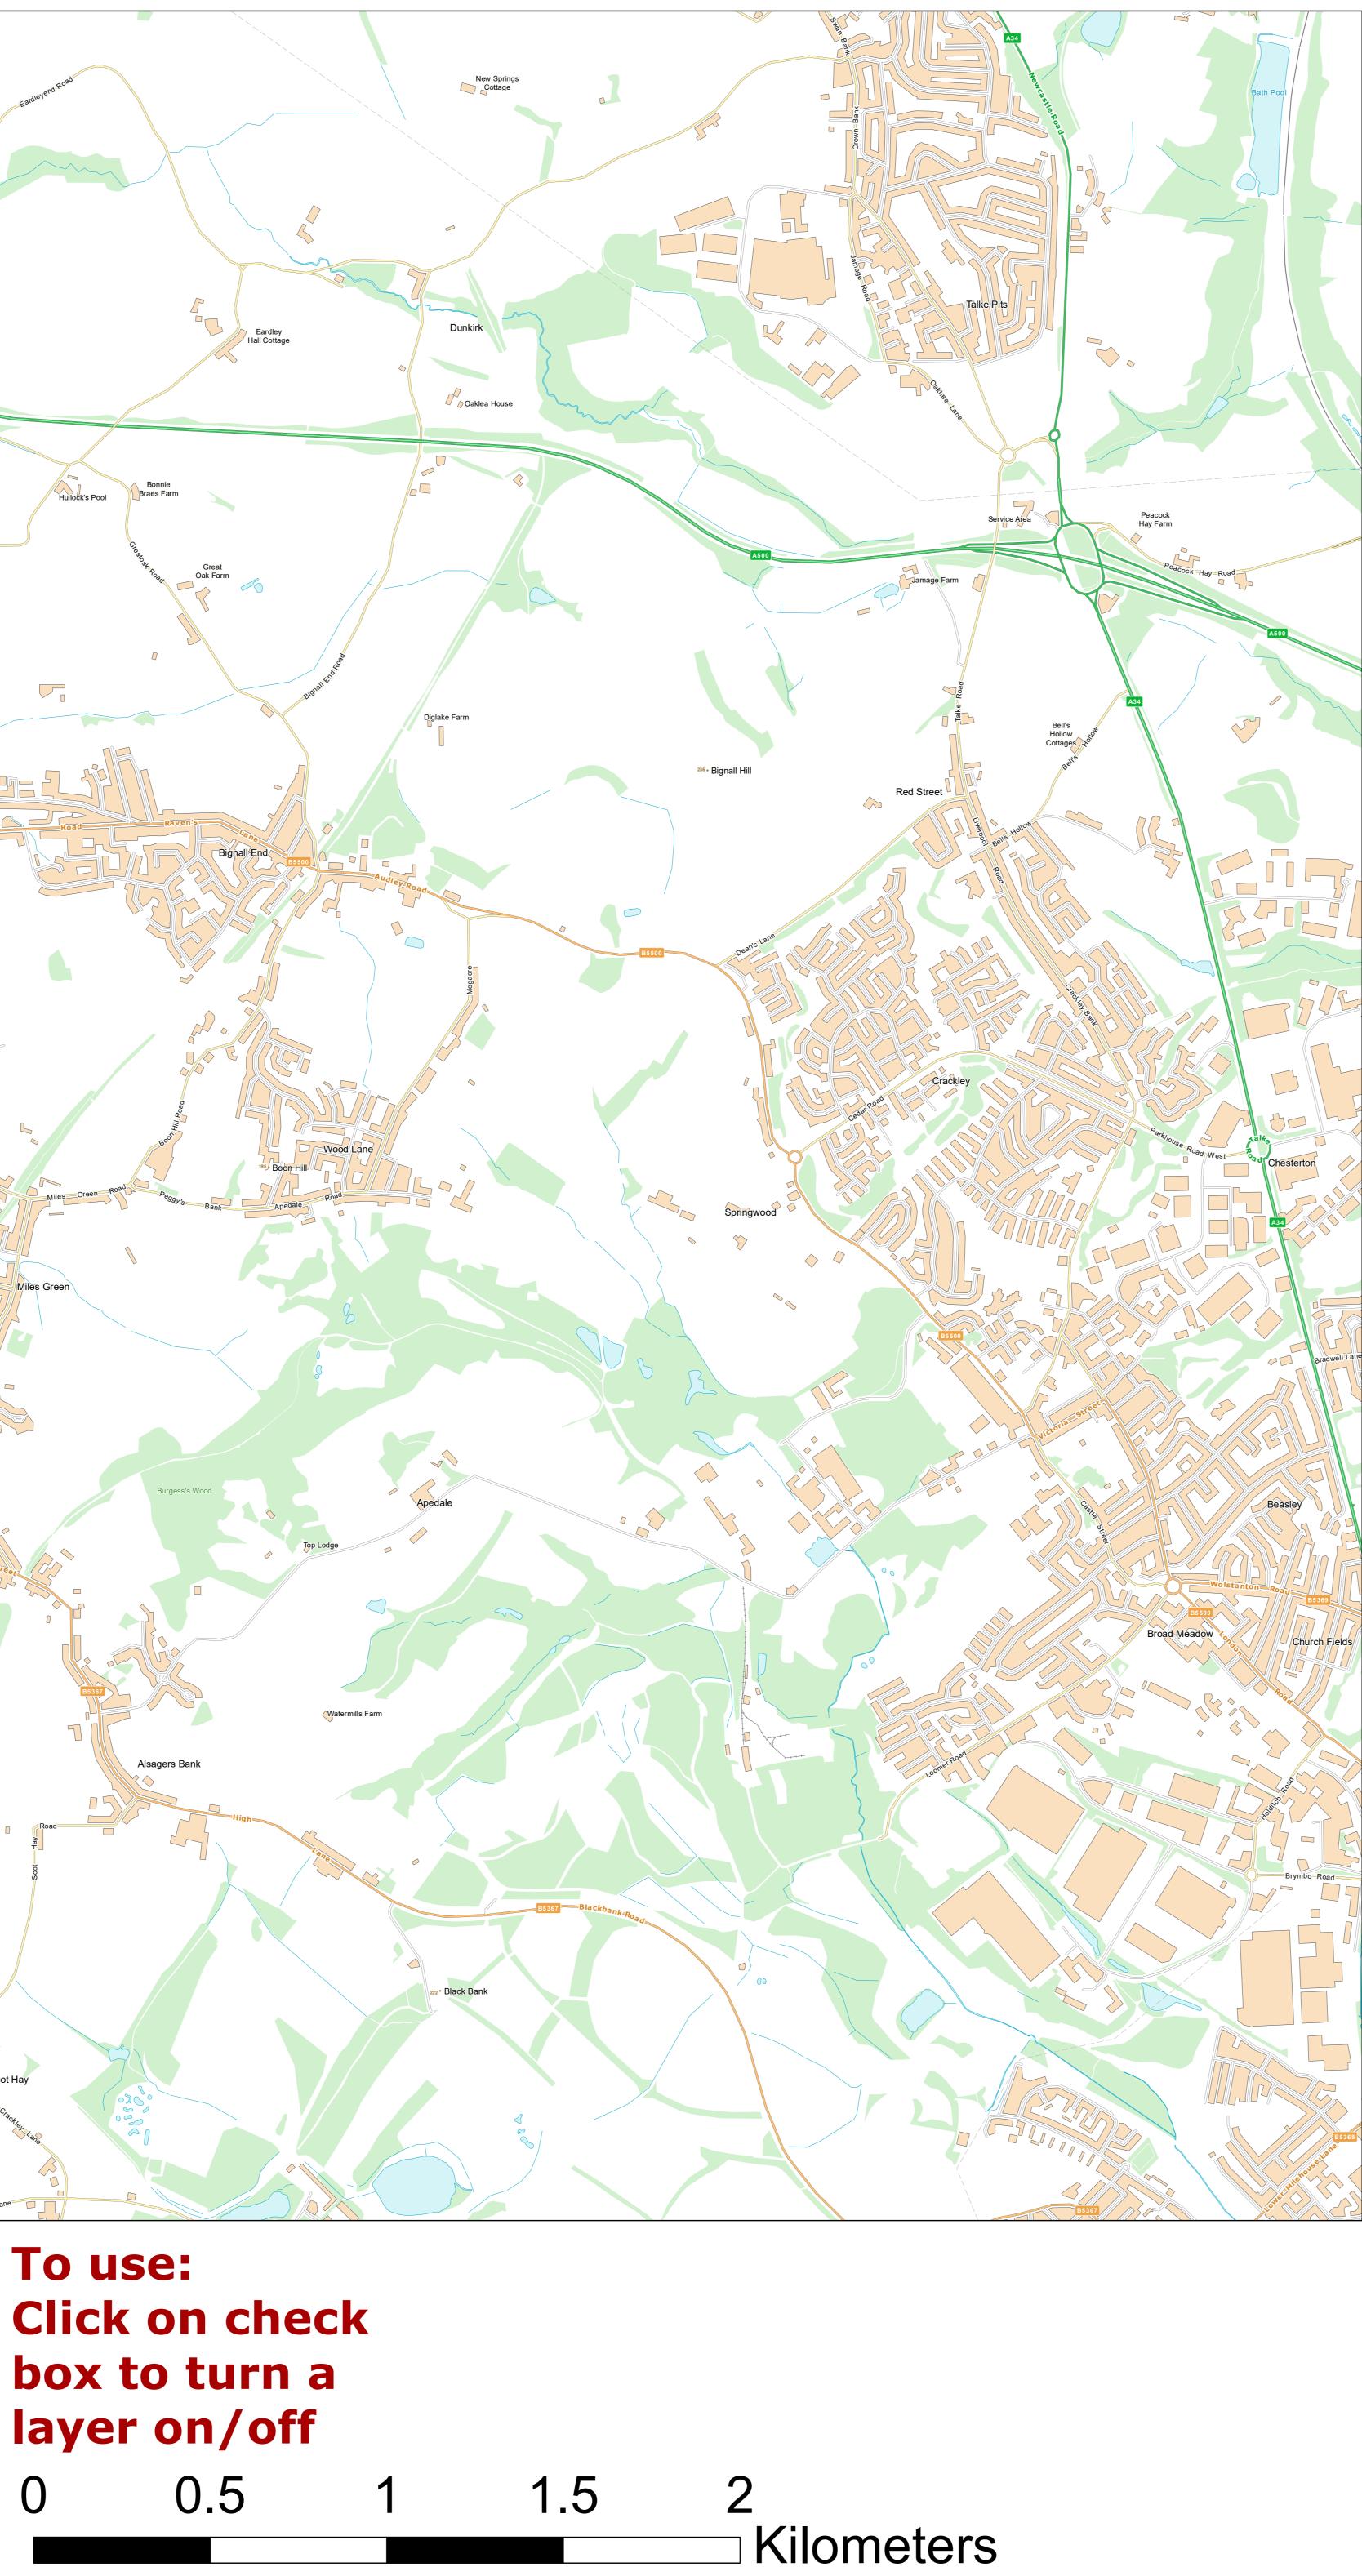

Newcastle-under-Lyme Borough Level 1 Strategic Flood Risk Assessment

- Authority Information
- Newcastle-under-Lyme 'boundary
- Watercourses
- Main Rivers
- All watercourses
- 8m watercourse buffer
- -Canals

<u>Defences</u>

- Engineered High Ground
- -Natural High Ground
- Spillway
- Flood Zones (Fluvial)
- Flood Zone 3b
- Indicative Flood Zone 3b
- Flood Zone 3a
- Flood Zone 2

<u>Climate Change Extent (Modelled)</u>

- 3.3% AEP + 29% CC
- 3.3% AEP + 39% CC
- 3.3% AEP + 61% CC
- 1% AEP + 29/30% CC
- 1% AEP + 39% CC
- 1% AEP + 61% CC
- 0.1% AEP + 29% CC
- 0.1% AEP + 39% CC
- 0.1% AEP + 61% CC

<u>Reservoir Flood Extents (EA)</u>

- Dry Day
- Wet Day

Risk of Flood from Rivers and Sea (EA)

High High Low

Medium Very Low

Reduction in Risk of Flooding from Rivers and Sea

<u>Risk of Flooding From</u> Surface Water (EA) 3.3% AEP 1% AEP 0.1% AEP Surface Water Climate Change Extent (Modelled) 3.3% AEP Upper End 2070s CC 1% AEP Upper End 2070s CC <u>Groundwater Emergence</u> Mapping (JBA) Less than 0.025m below surface Between 0.025- 0.5m below surface Between 0.5-5m below surface At least 5m below surface No risk. <u>Groundwater Flooding</u> Susceptibility (EA) < 25% >= 25% <50% **—** >= 50% <75% >= 75% Water Company Boundaries Severn Trent Water United Utilities EA Flood Alert and Warning Areas Flood Warning Areas Flood Alert Areas